



Water System Operations Manager's Report

Engineering and Operations Committee


Item 7a

January 8, 2018

Current Operational Conditions

- 2018 initial SWP allocation is 15%
- SPW blend target is 100% for Weymouth and 75% for Diemer and Skinner
- CRA is currently at 2-pump flow
- Developing 2018 water management strategies utilizing WSDM principles
- December 2017 deliveries of 149 TAF were 27 TAF higher than December 2016

Major Shutdowns in Jan/Feb 2018

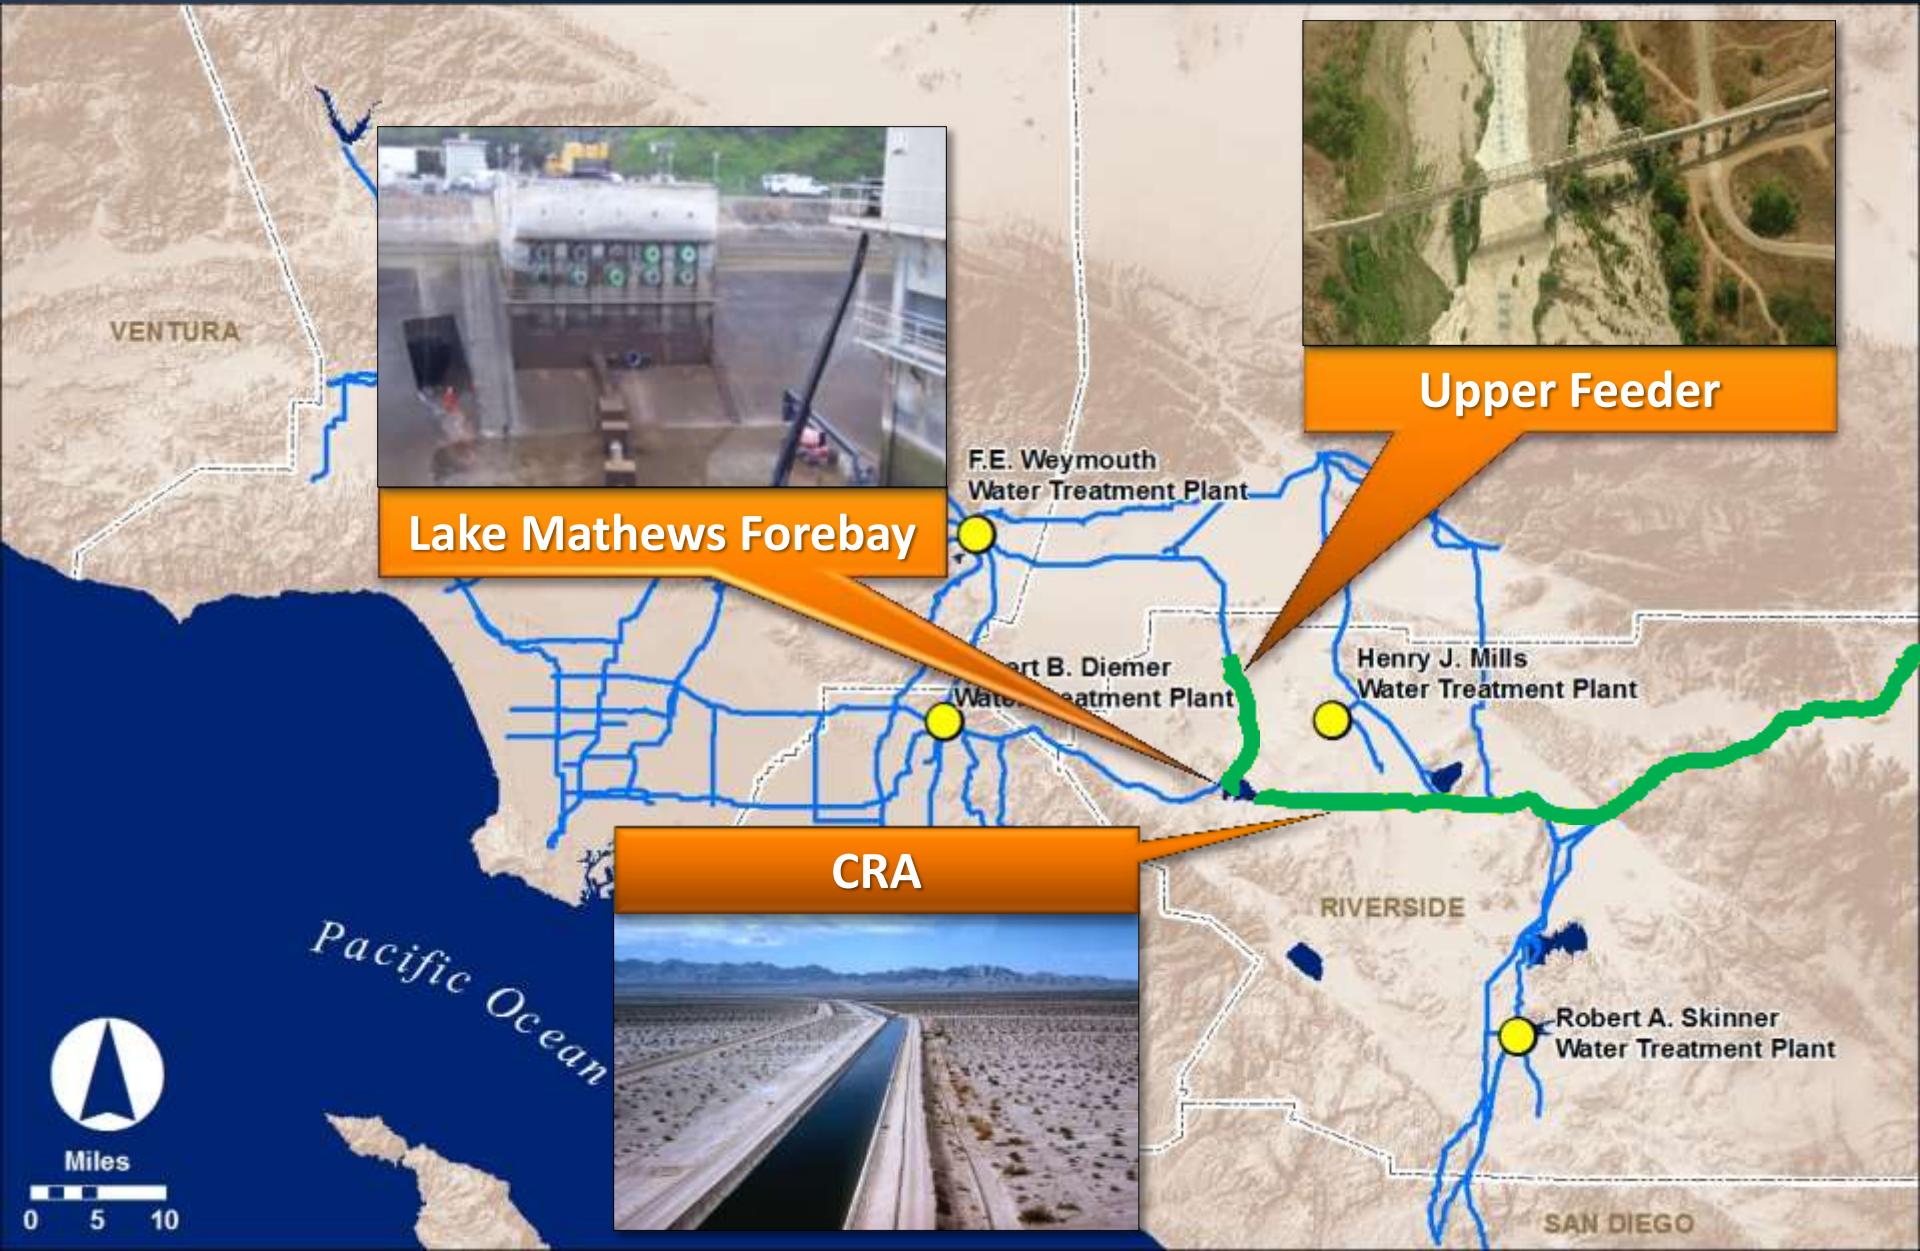

Colorado River Aqueduct Shutdown

February 13 – March 9, 2018

Performing annual maintenance, electrical testing, and seismic upgrades of CRA support facilities



